


NOTES:

1. COAT INTERIOR OF DIP OR RCP GRAVITY SEWERS AND DIP FORCE MAINS, SEE SPECIFICATIONS.
2. ELEVATION OF GRAVITY SEWER INVERT SHALL BE MINIMUM 1" ABOVE ELEVATION OF FORCE MAIN CROWN.
3. PROVIDE SMOOTH UPWARD SLOPING CHANNEL FROM FORCE MAIN TO GRAVITY SEWER.
4. FOR TRANSITION MANHOLE DETAILS FOR A GRINDER PUMP/PRESSURE SEWER SYSTEM, SEE PS/4.0 AND PS/4.1.

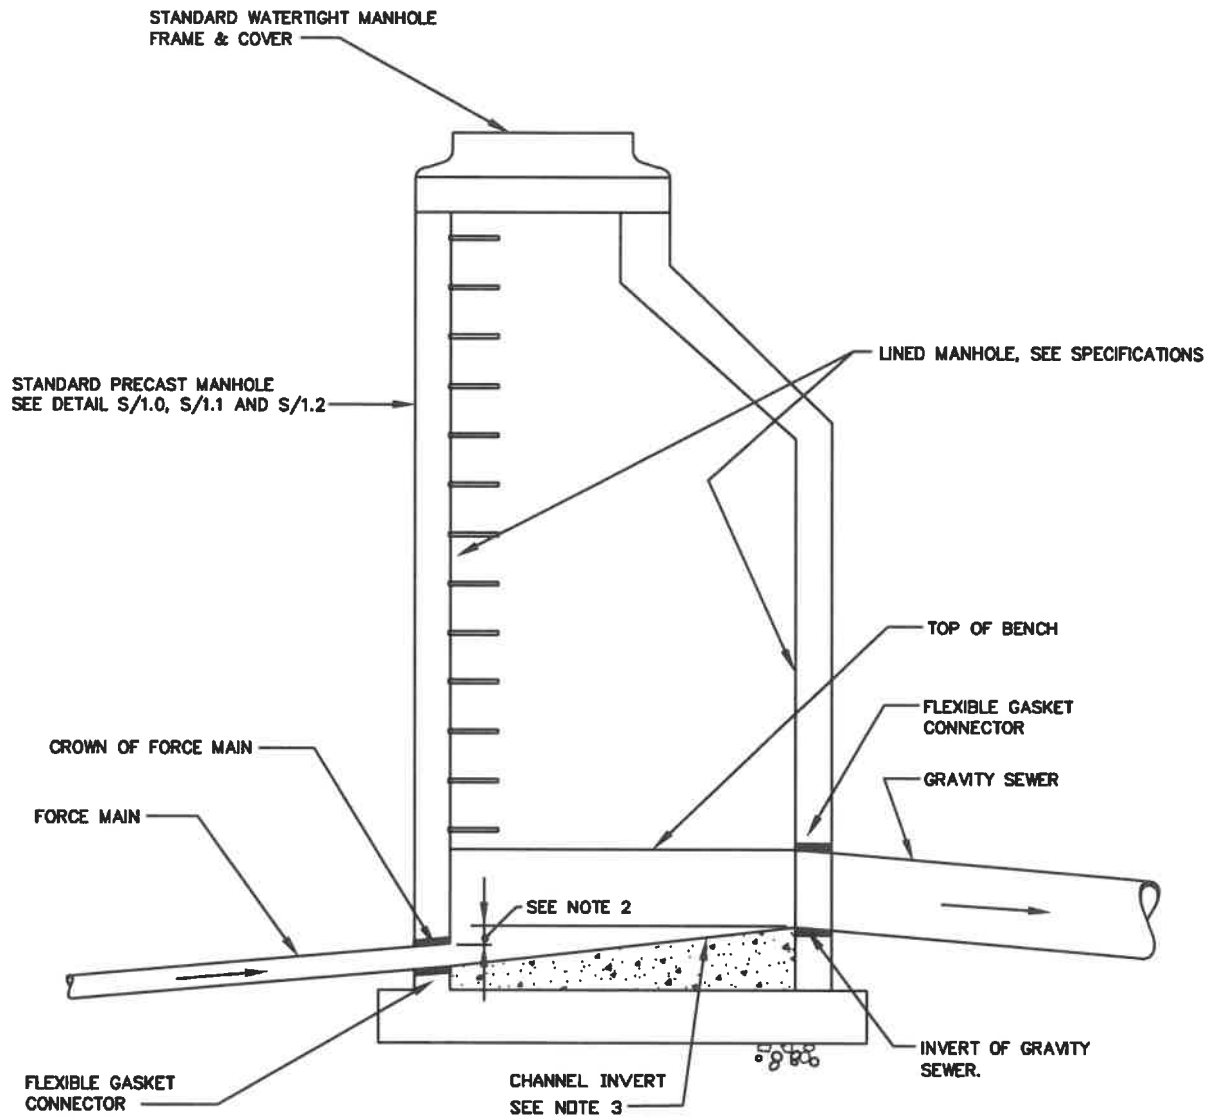

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7-5-21

M. W. Hammer
Chief Engineer

STANDARD DETAIL
TRANSITION MANHOLE
FORCE MAIN TO
GRAVITY SEWER

S
6.6