


**NOTE:**

1. NOTES (1) THRU (9) ON DETAIL S/1.0 APPLY TO THIS DETAIL.

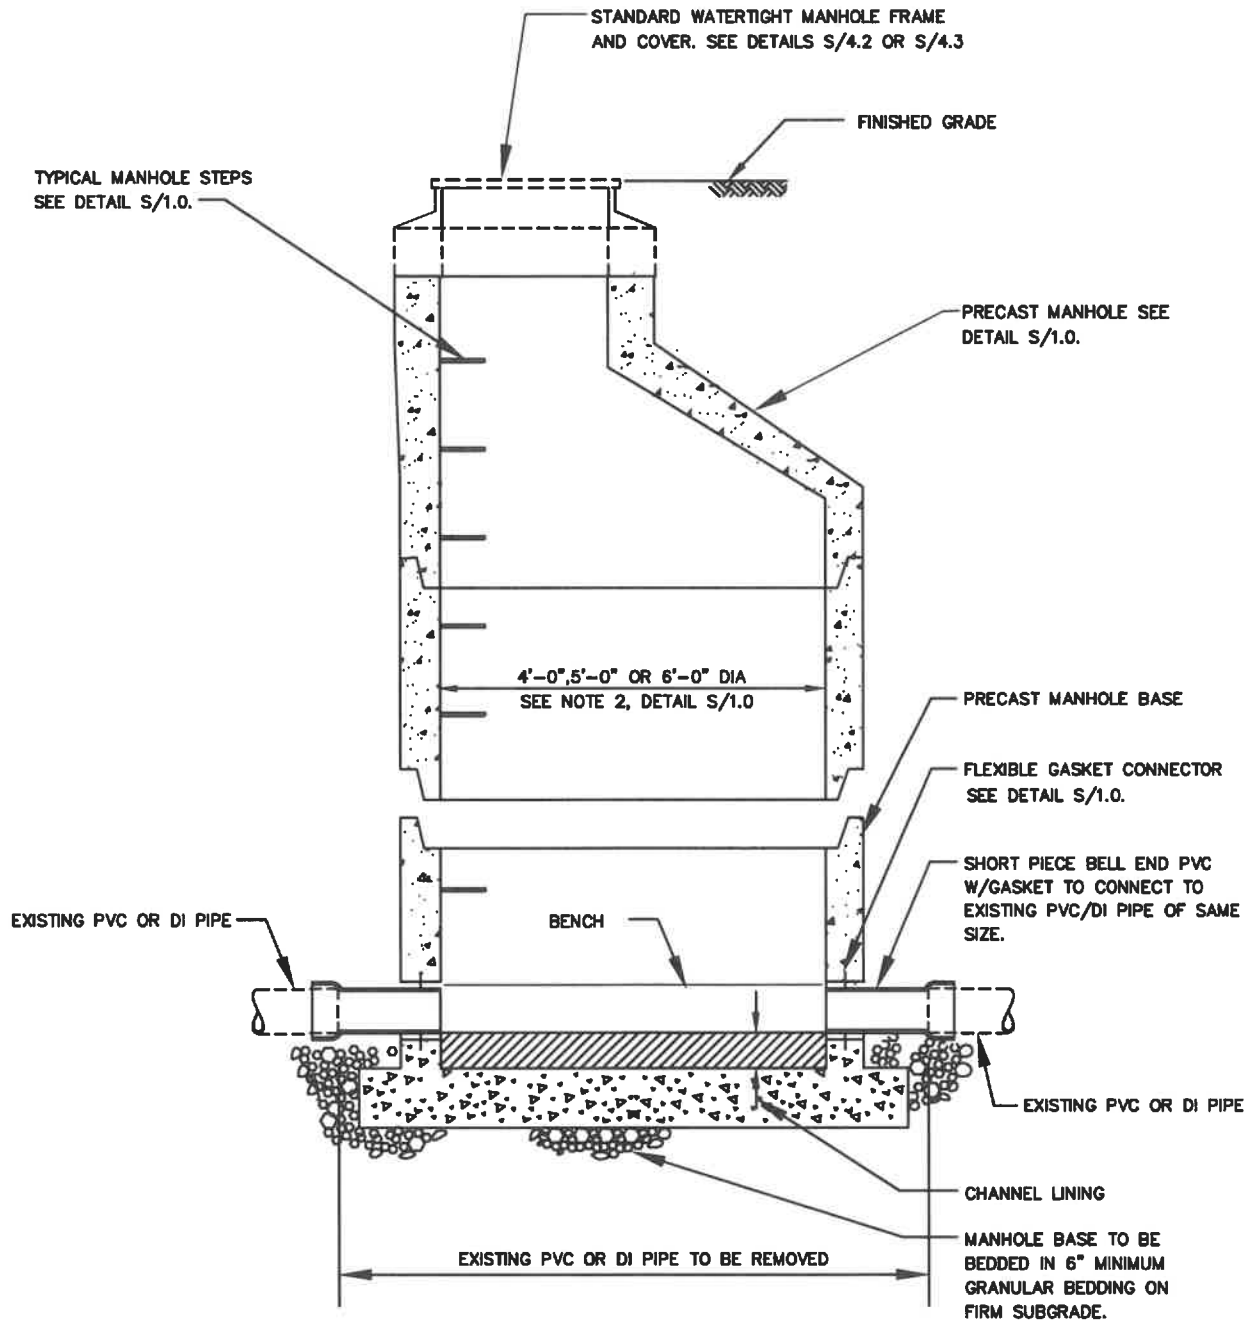

WASHINGTON  
SUBURBAN  
SANITARY  
COMMISSION

APPROVED: 7-7-21  
*Mike Hammer*  
Chief Engineer

STANDARD DETAIL  
PRECAST MANHOLE  
BUILT ON EXISTING  
PVC OR DI PIPE

S  
2.2