


TYPE OF HYDRANT	H (IN.)	
	MIN.	MAX.
KENNEDY VALVE	17 1/4	23 1/4
MUELLER COMPANY	18	24
U.S. PIPE VALVE & HYDRANT DIV.	18	24
CLOW VALVE CO.	19 3/8	25 3/8
AMERICAN FLOW CONTROL	14	20

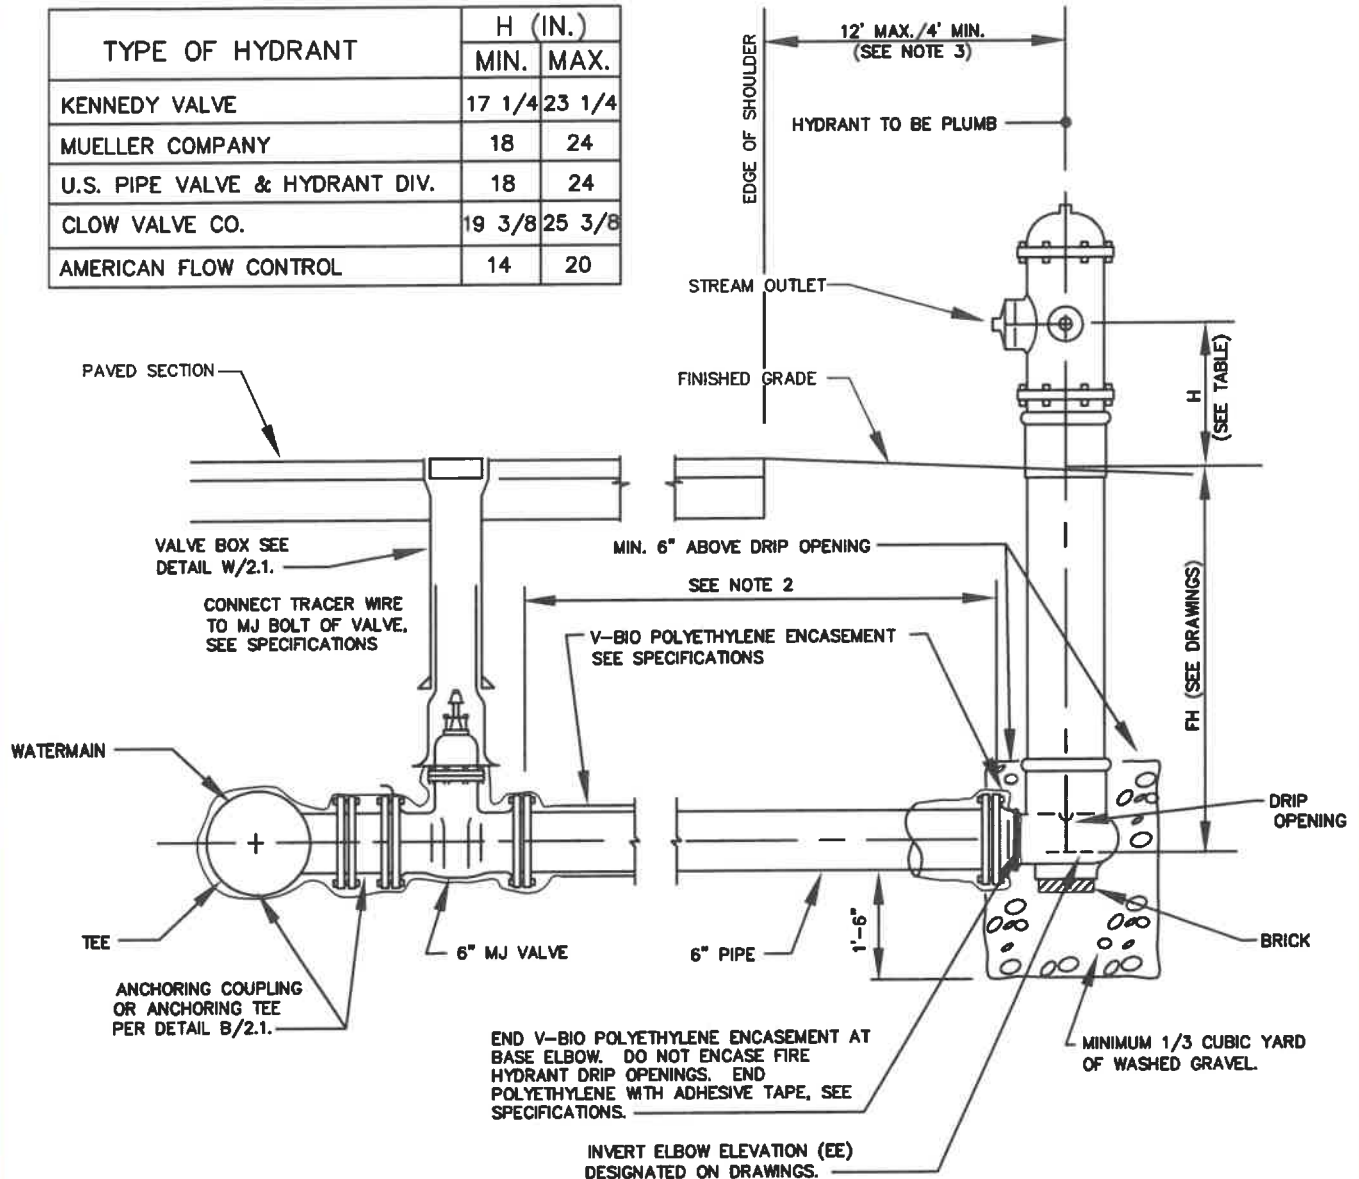

NOTES:

1. DO NOT BLOCK FIRE HYDRANT OR FIRE HYDRANT TEE.
2. FOR RESTRAINING VALVE TO FIRE HYDRANT, SEE DETAIL B/2.1.
3. PLACE FIRE HYDRANT PER COUNTY/JURISDICTIONAL REQUIREMENTS BUT NOT LESS THAN (4) FEET NOR MORE THAN TWELVE (12) FEET BEYOND THE LIMIT OF STABILIZED SHOULDER OR PAVEMENT AS SHOWN ON THE DRAWINGS.
4. FOR A LIST OF APPROVED TRAFFIC-MODEL FIRE HYDRANTS SEE SECTION 02510 OF THE STANDARD SPECIFICATIONS.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 10/26/21
M. H. Harmon
Chief Engineer

STANDARD DETAIL
**FIRE HYDRANT SETTING
OPEN PAVING SECTION**

W
8.1